


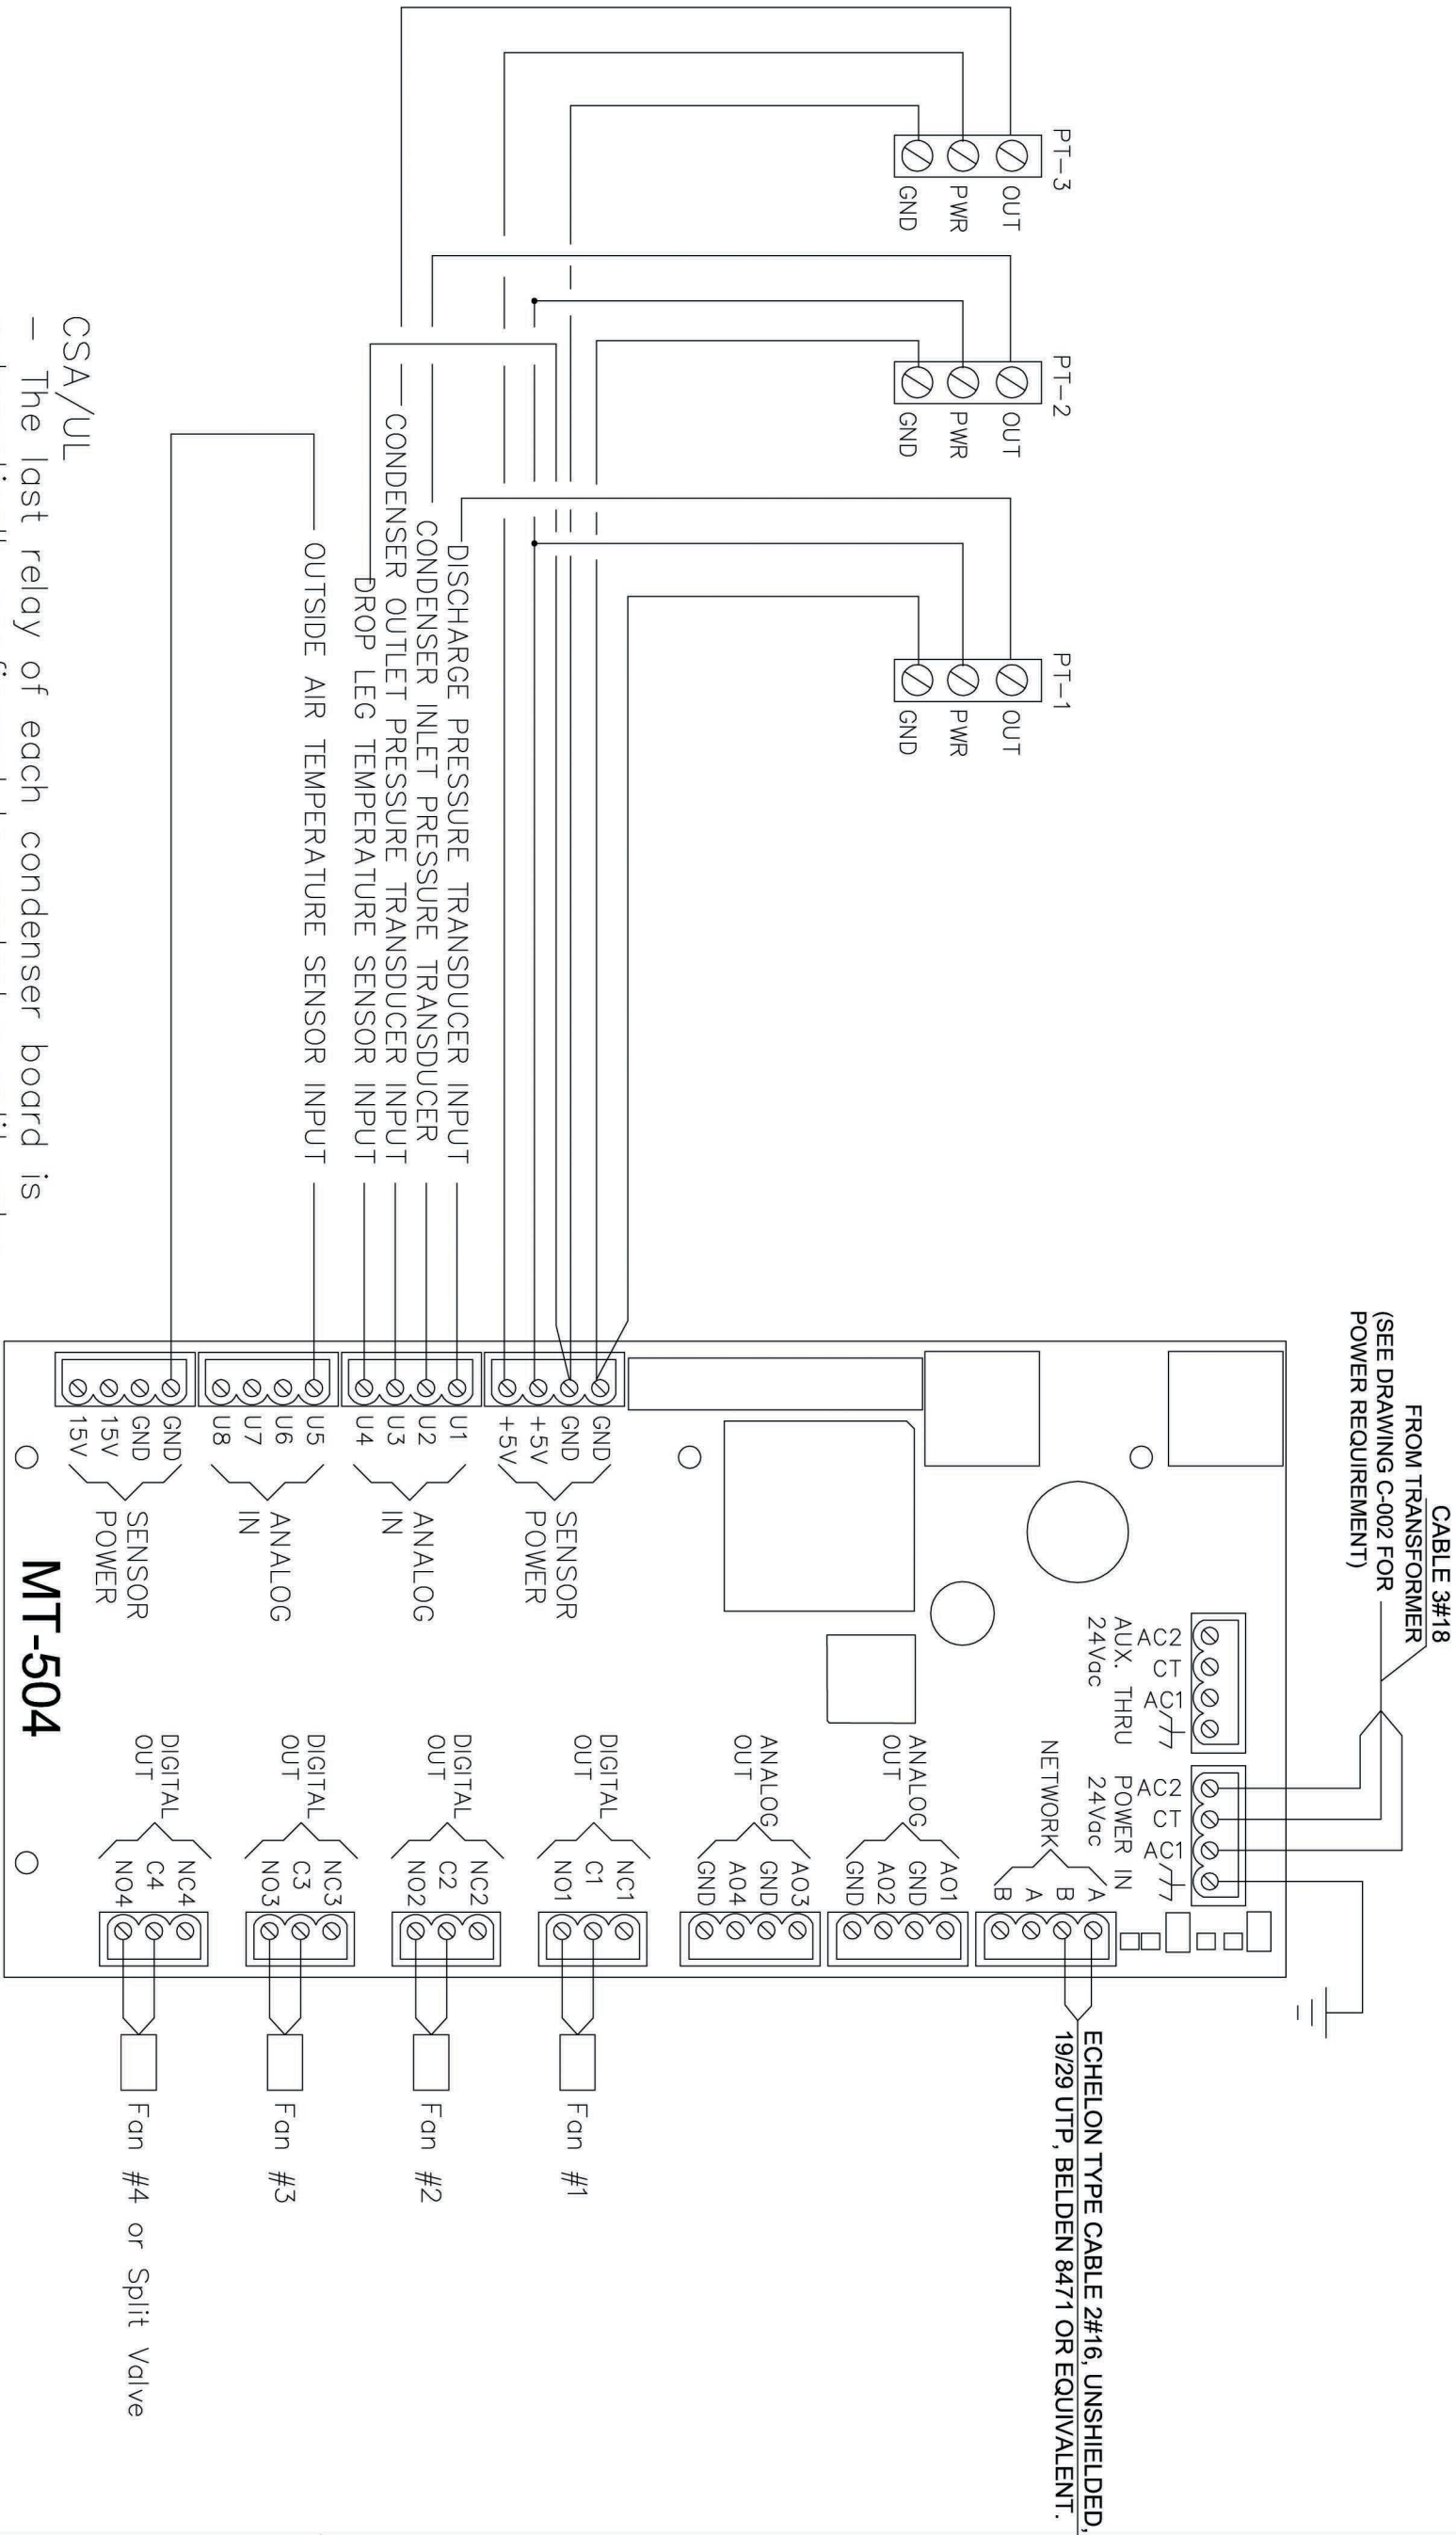

- CSA/UL
- The last relay of each condenser board is automatically configured to control a split valve if that relay is not being used for a fan.
 - All inputs can be network inputs.

	08
	07
	06
	05
	04
---	03
---	02
---	01
---	00
DATE	DESCRIPTION
REV.	

SYSTEM :

REFRIGERATION

AUTOMATION / CONTROL :

**MICRO THERMO**
T E C H N O L O G I E S

2584 boul. Le Corbusier
Laval, Quebec
Canada, H7S 2K8
Tel: (450) 668-3033
Fax: (450) 668-2695
e-mail : mt@microthermo.com

TITLE:
CONDENSER FAN
CONTROLLER

PART# 9XX504P

DRAWN BY :	DESIGN BY :	APPROVED BY :	PROJECT NO :
G.Q.	L.M.	A.H.	STANDARD
SCALE :	DATE :	SHEET NO :	FILE NAME:
N.T.S	08-23-2004	A-201	FAN_CTRL_MT-504